



Medtech32 Australia
Version 5.1.3/6.x.1/7.x.0/8.x.0
Medicare Australia Online
Vaccine Product Mapping Update
(July 2011)

Release Notes



These Release Notes contain important information for all Medtech32 users.
Please ensure that they are circulated amongst all your staff.
We suggest these should be filed safely for future reference.

Table of Contents

For further information on this release, or any other queries regarding the Vaccine Product Mapping Update (July 2011), please contact the Medtech Helpdesk on 1800 148 165 → Option 1, or email ausupport@Medtechglobal.com.

| | |
|-------------------------------|----------|
| Pre-requisites | 3 |
| Introduction | 5 |
| Installation | 7 |
| Setup | 9 |
| Vaccine Product Mapping | 9 |
| Inactive Test Vaccine | 11 |

Pre-requisites

Please review the following prerequisites and ensure they are met prior to running the Update:

IMPORTANT NOTE

This Update is intended for Medtech32 Version 5.1.3 (BUILD 1456 OR ABOVE) OR 6.x.1 (ANY BUILD) OR Version 7.x.0 (ANY BUILD) OR Version 8.x.0 (ANY BUILD) ONLY. If you ARE NOT on these Medtech32 Versions then please DO NOT continue.

This can be checked by logging into Medtech32 and selecting *Help* ▶ *About Medtech32*.

- Ensure the person(s) who will be performing the upgrade have **READ THROUGH** these notes.

IMPORTANT: This document contains valuable information that, if not read, could seriously affect the upgrade progress and/or possible down time of your network.

- Ensure you are ALWAYS logged onto Windows with **ADMINISTRATIVE RIGHTS** when performing ANY installation, update, or maintenance tasks.
- "**User Account Control**" (**UAC**) **MUST** be **DISABLED** as a policy across ALL Server and Client computers that are running on **Windows Vista or Windows 7 or Windows 2008**.
- To avoid unnecessary problems during installation, upgrade, or maintenance, preferably you should ALWAYS log onto Windows in "**Console Mode**" – i.e. not through Remote Desktop Connection, Terminal Services, or Citrix.
- Ensure you have a **COMPLETE** backup of ALL databases located in the MT32\Data directory.
- Ensure ALL users (including remote users) have **LOGGED OUT** of Medtech32 and ALL services (e.g. ManageMyHealth SMS Communicator), scheduled utilities (e.g. Message Transfer Utility, Auto Scan from Folder), backup or maintenance tasks (e.g. Interbase Backup Scripts) that require access to the databases have been **STOPPED**.

- Ensure the LAST Database you have logged in LOCALLY on the Medtech32 Server is the one you would like this update to run on.
NOTE: If unsure, simply login to the CORRECT database from the Medtech32 Server, then log out and close Medtech32 before continuing.

Introduction

With the recent introduction of the new vaccines Influvac and Prevanar 13 and the changes in some of the existing Medicare ACIR vaccines, the corresponding Medicare ACIR Vaccine Code for these vaccines need to be updated within your Medtech32 database. This will enable mapping from within Medtech32 Setup (*Setup ▶ Recall/Screening ▶ Vaccine Product Mapping*) to the new vaccine codes.

After running this update, sites will be able to register the new and updated vaccines to ACIR via Medicare Australia Online.

The following is a summary of what will be changed by this Update:

| ACIR Vaccine Code / Description (Old) | ACIR Vaccine Code / Description (New) | Change Type |
|---------------------------------------|---------------------------------------|---------------------|
| | PRVTH / Prevanar 13 | New Code |
| | INFLUV / Influvac | New Code |
| SYNFX / Synflorix | SYNFLX / Synflorix | Code changed |
| GNBRUB / Generic Rubella | GNRUB / Generic Rubella | Code changed |
| PRVTH / Prevanar | PRVNR / Prevanar 7 | Description changed |
| ROTRIX / Rotarix - Rotavirus | ROTRIX / Rotarix | Description changed |
| ROTTEQ / RotaTeq - Rotavirus | ROTTEQ / RotaTeq | Description changed |
| PLCL / Poilicel | PLCL / Poliacel | Description changed |
| PRPT / ActHib | PRPT / ActHIB | Description changed |
| IFHX / Infanrix-Hexa | IFHX / Infanrix Hexa | Description changed |
| IFPA / Infanrix-Penta | IFPA / Infanrix Penta | Description changed |
| DTP / Triple antigen | DTP / Triple Antigen | Description changed |
| MENVAX / Mencevax ACWY | MENVAX / Mencevax ACWY | Description changed |

- It will add the new Medicare ACIR vaccines as listed above.
- It will update the Code and Description of the existing Medicare ACIR vaccines as listed above.
- It will recreate any current Medicare ACIR vaccines that are missing from your Medtech32 database.
- It will remove any invalid or obsolete Medicare ACIR vaccines from your Medtech32 database.
- It will remove any duplicated Medicare ACIR vaccines from your Medtech32 database.
NOTE: If the Utility is unable determine which of the duplicated records should be kept, all duplicates will be deleted and the corresponding Medicare ACIR vaccine will then be recreated.

- For all newly added or recreated Medicare ACIR vaccines, the Utility will default the Medtech32 Vaccine Code (MT32 Vaccine) to 'TEST', and the Medtech32 Vaccine Product Code (MT32 Code) to 'TEST' under Vaccine Product Mapping.
- All existing Vaccine Product Mapping WILL NOT be altered, except for those Medicare ACIR vaccines that are recreated by the Utility.

IMPORTANT NOTE

WARNING: It is HIGHLY recommended to employ ONLY qualified system engineers when performing ANY installation and upgrade. The consequences of ruining a database during upgrade could possibly lead to data corruptions, and as a result – data loss and systems downtime.

If in doubt, please consult with your IT technician/service provider, or contact one of the Medtech Channel Partners listed on our web site:

<http://www.medtechglobal.com/aus/medtech-online-au/support-3.html>

Installation

The Vaccine Product Mapping Update (July 2011) must be run on the Medtech32 Server machine. The following procedures ONLY need to be run ONCE for EACH practice (or once per database if your practice has multiple databases).

NOTE: If you are uncertain which computer is the MedTech32 Server, please contact your IT technician or service provider who has performed the MedTech32 installation and/or upgrade.


1. Please visit our website at www.medtechglobal.com.
2. Select **Region: Australia** from the Region dropdown list on the top right corner of the screen.



The Australia Home Page will be displayed.




3. Select from the Top Menu, **medtech online ► medtech32 ► downloads**. The Australia Medtech32 Downloads page will be displayed.

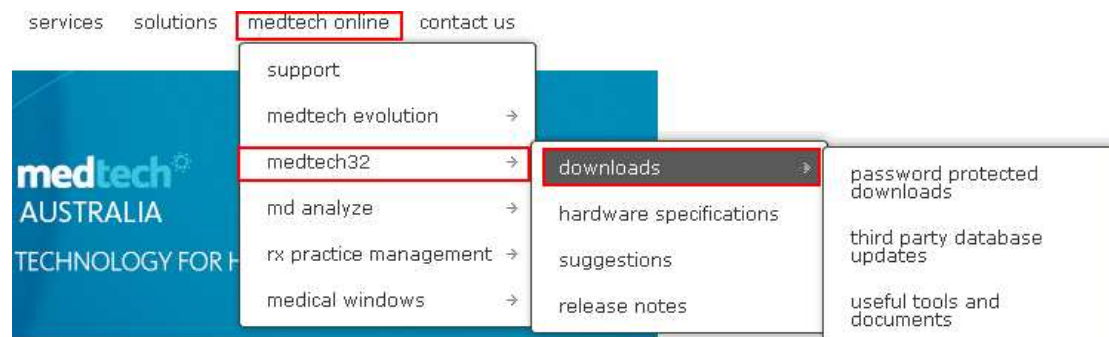

4. Here you will find the **Vaccine Product Mapping Update (July 2011)**.
5. Click on the Link **Vaccine Product Mapping Update (July 2011)**.

6. If the File Download Security Warning dialogue box appears, select the **Run** option.
7. If the Open File Security Warning dialogue box appears, select the **Run** option.
8. The Vaccine Product Mapping Update screen will be displayed. Click on the Button **OK** to begin running the Update.

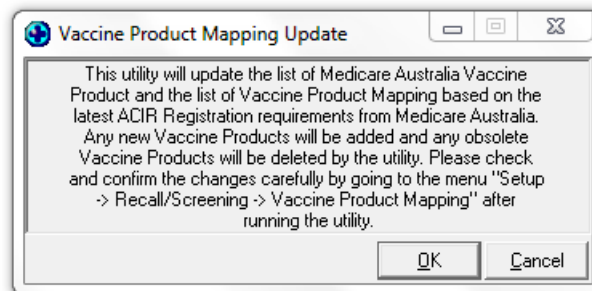

9. Once the Update is completed, the following screen will be displayed. Click on the Button **OK** to exit the Update.



Setup

Vaccine Product Mapping


Setup ▶ Recall/Screening ▶ Vaccine Product Mapping

IMPORTANT: As Medicare Australia requires specific vaccine codes to be transmitted for ACIR Registration, **ALL** Vaccine Product Mapping must be mapped correctly.

Please follow the steps below to map current Vaccine Codes and Vaccine Product Codes in the Medtech32 database to the required Medicare Australia Vaccine Codes.

To map Vaccine Product Codes:

1. Select Setup ▶ Recall/Screening ▶ Vaccine Product Mapping. The Vaccine Product Code Mapping table will be displayed.

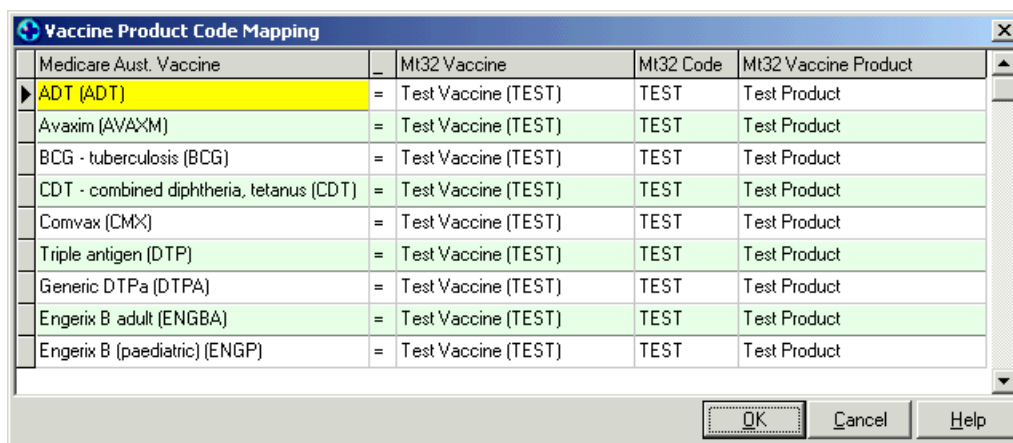

| Medicare Aust. Vaccine | MT32 Vaccine | MT32 Code | MT32 Vaccine Product |
|--|-----------------------|-----------|----------------------|
| ▶ ADT (ADT) | = Test Vaccine (TEST) | TEST | Test Product |
| Avaxim (AVAXM) | = Test Vaccine (TEST) | TEST | Test Product |
| BCG - tuberculosis (BCG) | = Test Vaccine (TEST) | TEST | Test Product |
| CDT - combined diphtheria, tetanus (CDT) | = Test Vaccine (TEST) | TEST | Test Product |
| Comvax (CMX) | = Test Vaccine (TEST) | TEST | Test Product |
| Triple antigen (DTP) | = Test Vaccine (TEST) | TEST | Test Product |
| Generic DTPa (DTPA) | = Test Vaccine (TEST) | TEST | Test Product |
| Engerix B adult (ENGBA) | = Test Vaccine (TEST) | TEST | Test Product |
| Engerix B (paediatric) (ENGP) | = Test Vaccine (TEST) | TEST | Test Product |


The left hand column Medicare Aust. Vaccine will show a list of all official Medicare ACIR Vaccines (description and code).

The middle column MT32 Vaccine will show a dropdown list of all Medtech32 Vaccines (description and code) that are currently setup in the Medtech32 database (Setup ▶ Recall/Screening ▶ Vaccine)


The next column MT32 Code will show a dropdown list of all associated Product Codes that are currently setup under the selected Medtech32 Vaccine (Setup ▶ Recall/Screening ▶ Vaccine – Product Tab)

The right hand column MT32 Vaccine Product will show the description of the Product Code that is selected under the column MT32 Code.


2. Select from the *MT32 Vaccine* dropdown list the Medtech32 Vaccine that matches the Medicare ACIR Vaccine.

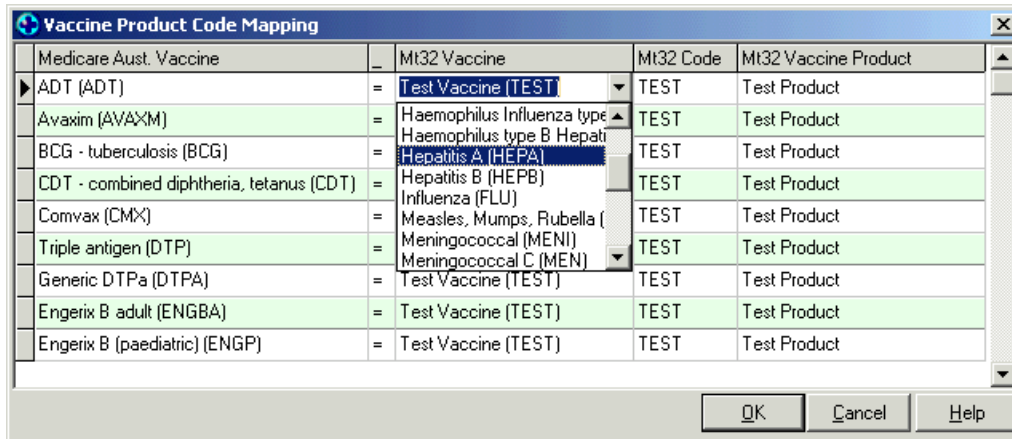

3. Select from the *MT32 Code* dropdown list the Medtech32 Product Code that matches the Medicare ACIR Vaccine.

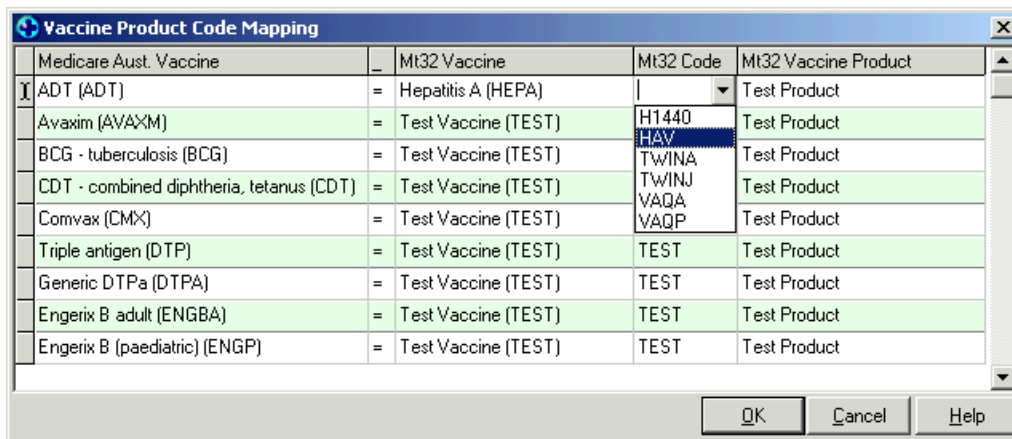

4. The *MT32 Vaccine Product* field will display the description of the Product Code that is selected under the column *MT32 Code*.

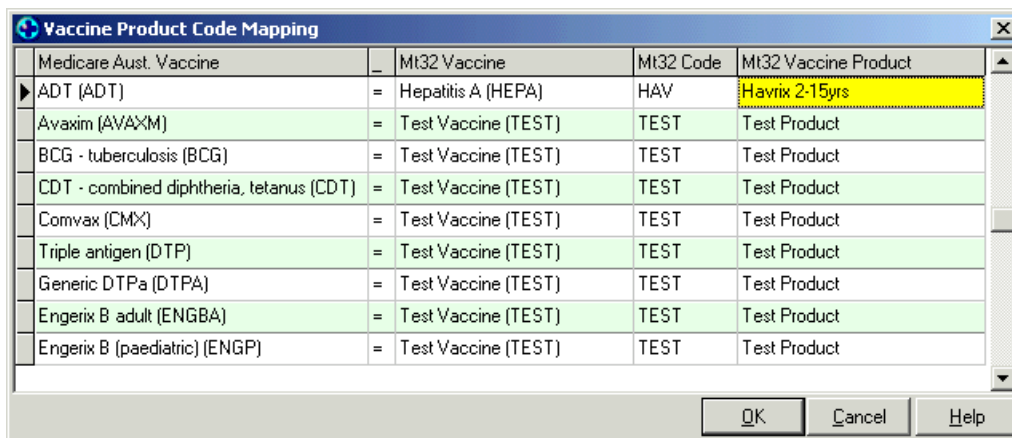

Once completed, the mapping will ensure that when sending an ACIR Registration to Medicare Australia from within Medtech32, the correct Medicare ACIR Vaccine Code will be transmitted.


IMPORTANT: If any Medtech32 Vaccine Codes (*MT32 Vaccine*) or Vaccine Product Codes (*MT32 Code*) have been made "inactive", the corresponding Medicare ACIR Vaccine Code (*Medicare Aust. Vaccine*) will **NO LONGER** be displayed for mapping.

Before inactivating any Medtech32 Vaccine Codes or Vaccine Product Codes, you **MUST FIRST** remap the corresponding Medicare ACIR Vaccine Code (*Medicare Aust. Vaccine*) to another **CURRENTLY ACTIVE** Medtech32 Vaccine Code or Vaccine Product Code.

Inactive Test Vaccine

Setup ▶ Recall/Screening ▶ Vaccine

Once **ALL** Vaccine Product Mapping have been completed, you can safely inactive the 'Test Vaccine' created by the Utility by going to Setup ▶ Recall/Screening ▶ Vaccine.

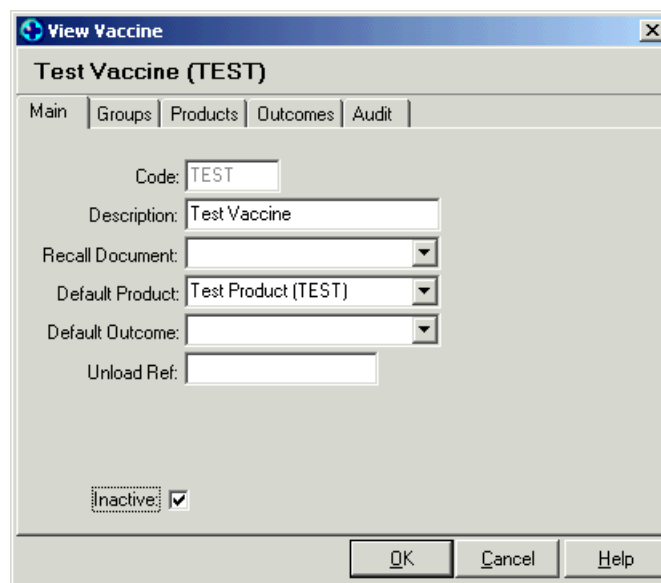

1. Open up the 'TEST' vaccine by double clicking on it.
2. Tick the Checkbox **Inactive**.
3. Click on the Button **OK**.

Should you require any assistance, please do not hesitate to contact the Medtech Helpdesk on 1800 148 165 → Option 1, or email ausupport@medtechglobal.com.