

# Release Notes

## Medtech Evolution

Version 10.3.0 Build 5457  
(July 2017)



*These release notes contain important information for Medtech users. Please ensure that they are circulated amongst all relevant staff. We suggest that they are filed safely for future reference.*

Contents

- 1. Introduction ..... 3
- 2. Enhancements ..... 4
  - 2.1 Print selected patient documents and medications change..... 4
  - 2.2 Reason for visit validation removed..... 4
  - 2.3 Create new document from an existing document..... 5
  - 2.4 Inbox records to display in reverse chronological order ..... 5
  - 2.5 New option to print from PDF Viewer control ..... 5
- 3 Resolved Issues ..... 7
  - 3.1 Appointment Pad auto-refresh issue ..... 7
  - 3.2 Not Valid date Issue in Appointment Pad ..... 7
  - 3.3 EinterbaseError issue ..... 7
  - 3.4 Cursor Issue in Appointment Book..... 7
  - 3.5 Scroll bar issue in Inbox and Outbox window ..... 7
  - 3.6 Space in Appointment Slots Issue ..... 7

## 1. INTRODUCTION

**Medtech Evolution Version 10.3.0 Build 5457** is a Patch Release of Medtech Evolution. This document provides an overview of the resolved issues and changes to the Medtech Evolution application.

Please ensure that this document is read and circulated amongst the practice staff.

**NOTE:** Please ONLY run the upgrade at a time when your site is not required to be up and running in a short amount of time. It is recommended that you run the upgrade after hours or on the weekend when you would have adequate time to complete the upgrade.

The amount of time required to run the upgrade is dependent on the specification of your server and the size of ALL databases.

**WARNING:** It is HIGHLY recommended to employ ONLY qualified system engineers when performing ANY installation and upgrade. The consequences of ruining a database during upgrade could possibly lead to data corruptions and, as a result, data loss and systems downtime.

If in doubt, please consult with your qualified IT technician/service provider or contact one of the Medtech Channel Partners listed on our website:


<http://www.medtechglobal.com/au/support-au/channel-partners-au/>

## 2. ENHANCEMENTS

### 2.1 Print selected patient documents and medications change

In earlier versions of Medtech Evolution, when adding a new medication or Outbox document for a patient, check boxes of all the unprinted Medication and Outbox documents would be auto-ticked.

This functionality is changed in Medtech Evolution v 10.3.0, if a provider or clinician unselects any specific Medication or Outbox documents available in the Consultation screen, then adding a new medication or Outbox document will not auto-select the unprinted Medication and Outbox documents.

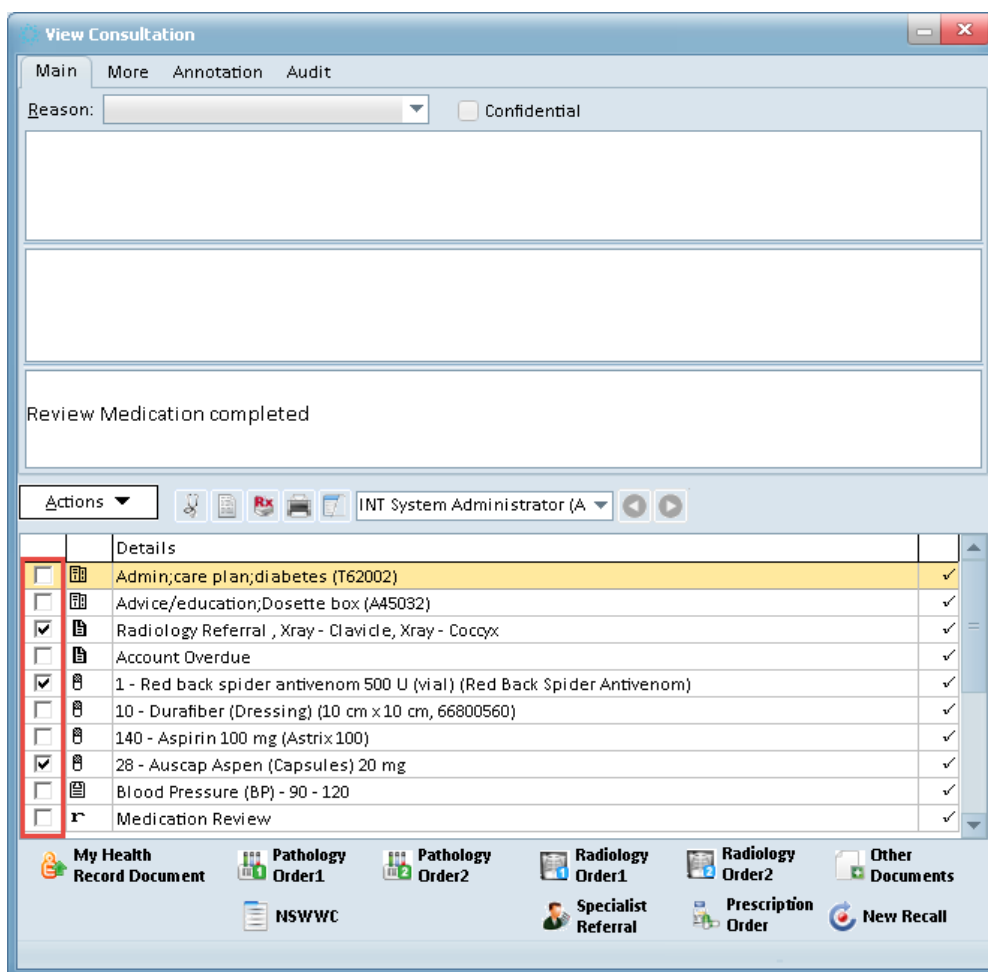

Only the newly added Medication and Outbox documents will be auto selected in the Consultation screen.

### 2.2 Reason for visit validation removed


In earlier versions of Medtech Evolution, 'Reason for visit' in Consultation screen would appear as mandatory if MHR Consent is ticked in the patient register.

This validation is now removed in Medtech Evolution v 10.3.0 Build 5457.

## 2.3 Create new document from an existing document

A new option 'Duplicate as New' is introduced in Patient Outbox window to create a duplicate document of selected document.

In the Patient Outbox window, select or highlight a document and choose 'Duplicate as New' or press 'Ctrl + U' to open a new document with the selected documents details (duplicate the document). This will enable the clinician to modify and save it as a new document.

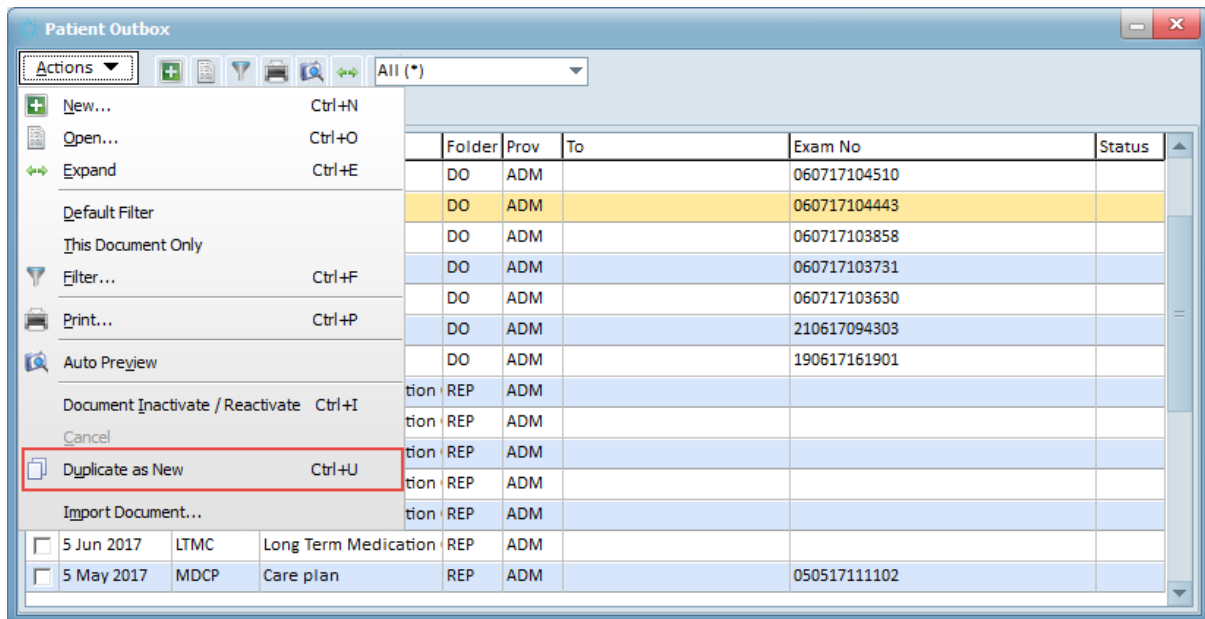

### NOTE

This option will not be enabled for the following documents and documents format.

#### Document

1. Laboratory order (LAB)
2. Radiology Referral (RAD)
3. Inactivated documents

#### Document Format

1. HTML (H)
2. ManageMyHealth SMS (S)


## 2.4 Inbox records to display in reverse chronological order

In Medtech Evolution v 10.3.0 Build 5457, the Patient Inbox and Provider Inbox screen will display the records in reverse chronological order i.e. newly added records will display first in Patient Inbox and Provider Inbox.

## 2.5 New option to print from PDF Viewer control

A new button ' ? ' is introduced in Module → Inbox → Patient/Provider Inbox → View Inbox/Scan → Document/PDF tab and Module → Outbox → Patient/Provider Outbox → View Patient document → Attachment tab to print the PDF content of the Patient Inbox and Outbox documents

This option is enabled only for Inbox and Outbox records which are in PDF format. Click the  button and select 'Print' Menu to print the PDF content to your default selected printer.

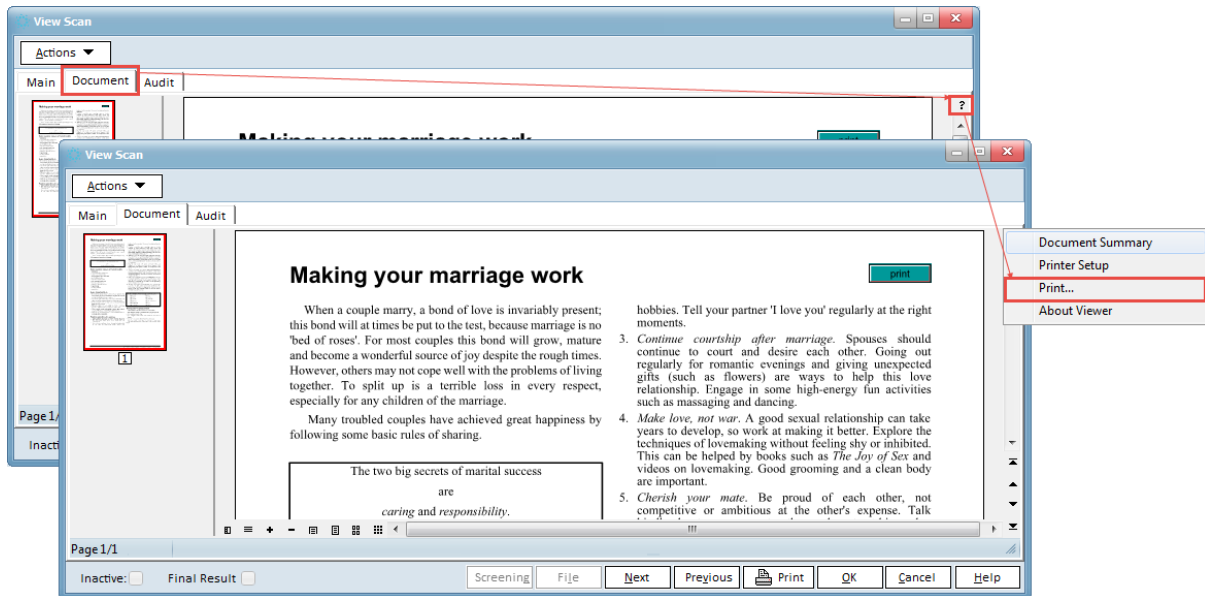

## 3 RESOLVED ISSUES

### 3.1 Appointment Pad auto-refresh issue

In earlier versions of Medtech Evolution, there was an issue with auto refreshing appointments in the appointment pad and their appearance (missing content).

This issue is now resolved. All the appointment slots will be displayed for all the configured providers in the Appointment Pad.

### 3.2 Not Valid date Issue in Appointment Pad

In earlier versions of Medtech Evolution, if the UDF is configured as '0' in Appointment Pad setup, then a user is able to edit the time columns in the Appointment Pad which results in displaying 'is not a Valid date and time' error message.

This Issue is now resolved.

### 3.3 EinterbaseError issue

In earlier version of Medtech Evolution, an 'Einterbaseerror' message is displayed when making an appointment for the guest patient in the appointment pad.

This issue is now resolved.

### 3.4 Cursor Issue in Appointment Book

In earlier versions of Medtech Evolution, there was an issue when hovering the mouse over the Appointment Book. On hovering the mouse over the Appointment Book the cursor and set focus would be in the Appointment Book.

This issue is now resolved. Hovering the mouse over the Appointment Book will not place the cursor or set the focus in the Appointment Book

### 3.5 Scroll bar issue in Inbox and Outbox window

In earlier the versions of Medtech Evolution, the scroll bar in the Patient Inbox, Provider Inbox, Patient Outbox and Provider Outbox would not scroll properly when clicking the icon in the vertical scroll bar.

This issue is now resolved.

### 3.6 Space in Appointment Slots Issue

In earlier the versions of Medtech Evolution, if a guest user name is entered and cleared from an Appointment slot, an empty appointment would appear in the Database which displays a confirmation message when booking an appointment in the same slot.

This issue is now resolved.

Further information on these new features, or any other queries regarding the changes in this release, please contact Medtech Support via:

- Medtech Evolution application [Help ► Contact Support]
- Email to [supportau@medtechglobal.com](mailto:supportau@medtechglobal.com)
- Fax to 03 9690 8010 - Attn: Medtech Support
- Phone on 1800 148 165